

FLAMEOFF COATINGS, INC. TEST REPORT

SCOPE OF WORK

TAPPI T461 CM-09 FLAME RESISTANCE OF TREATED PAPER AND PAPERBOARD TESTING ON
TYPE 1 PAPER TREATED WITH FR CLEAR 40%.

REPORT NUMBER

105712706MID-002

TEST DATE(S)

02/19/24

ISSUE DATE

02/20/24

[REVISED DATE]

N/A


PAGES

4

DOCUMENT CONTROL NUMBER

GFT-OP-10c (09/29/20)

© 2017 INTERTEK

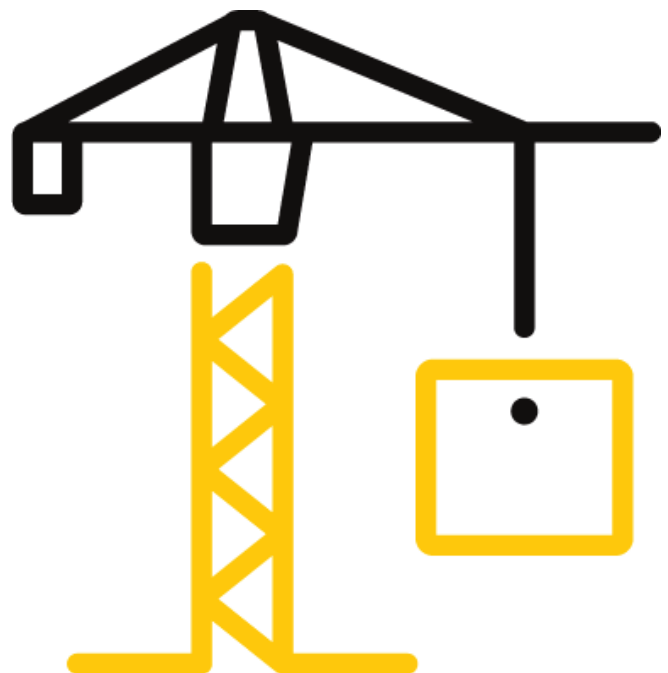

TEST REPORT FOR FLAMEOFF COATINGS, INC.

Report No.: 105712706MID-002

Date: 02/20/24

REPORT ISSUED TO

FLAMEOFF COATINGS, INC.

5323 Griffith Park Road
Raleigh, NC 27613

SECTION 1

SCOPE

Intertek Testing Services NA, Inc. dba Intertek Building & Construction (B&C) was contracted by FlameOff Coatings, Inc., 5323 Griffith Park Road, Raleigh, NC 27613 to perform testing in accordance with TAPPI T461 cm-09-*Flame resistance of treated paper and paperboard*, on their Type 1 Paper Treated with FR Clear 40%. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at Intertek test facility in Middleton, WI.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

Intertek B&C will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens (where required by Certification or Accreditation bodies), or other pertinent project documentation, will be retained for the entire test record retention period.

SECTION 2

SUMMARY OF TEST RESULTS

Type 1 Paper Treated with FR Clear 40% had an average char length of 49 mm.

For INTERTEK B&C:

COMPLETED BY:	Joel Zumwalt	REVIEWED BY:	Mark Crawford
TITLE:	Lab Technician II	TITLE:	Engineering Team Lead
SIGNATURE:		SIGNATURE:	
DATE:	02/20/24	DATE:	02/20/24

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR FLAMEOFF COATINGS, INC.

Report No.: 105712706MID-002

Date: 02/20/24

SECTION 3

TEST METHOD(S)

The specimens were evaluated in accordance with the following:

T 461 cm-09, *Flame resistance of treated paper and paperboard*

SECTION 4

MATERIAL SOURCE/INSTALLATION

Test samples were provided by the client. The results outlined in this report apply to the sample as received. Samples were received at the Evaluation Center on February 9, 2024 in good condition verified by Sample ID# MID2402091353-001.

SECTION 5

EQUIPMENT

EQUIPMENT			
DESCRIPTION - ASSET #:	Stopwatch - 1583	CALIBRATION DUE:	7/5/2024
DESCRIPTION - ASSET #:	Burner - 1476	VBU:	2/19/2024
DESCRIPTION - ASSET #:	Test Cabinet - 1204	CALIBRATION DUE:	FRO
DESCRIPTION - ASSET #:	Temp/Humid Reader Sample Rm - 1451	CALIBRATION DUE:	3/7/2024
DESCRIPTION - ASSET #:	Temp/Humid Reader - 1562	CALIBRATION DUE:	1/18/2025

SECTION 6

TEST PROCEDURE

Testing is conducted in accordance with Section 5.2 thru 5.3.2 of the Standard. 99.5% purity Methane was utilized for testing.

SECTION 7

TEST CRITERIA

The Standard has no specified performance requirements regarding pass/fail criteria

SECTION 8

TEST SPECIMEN DESCRIPTION

Samples were received as four approximately 215 mm by 70 mm panels tan in color. Two panels were in the machine direction and two panels were in the cross direction. These panels were allowed to condition in accordance with Section 5.2.1 of the Standard by Intertek prior to testing.

TEST REPORT FOR FLAMEOFF COATINGS, INC.

Report No.: 105712706MID-002

Date: 02/20/24

SECTION 9

TEST RESULTS

TEST RESULTS				
12 Second Flame Exposure Control 1 Not Treated				
Specimen	Direction	Flame Duration (Sec.)	Glowing Time (Sec.)	Char Length (mm)
1	MD	0	0	47
2	MD	0	0	52
3	CD	0	0	55
4	CD	0	0	43
AVERAGE		0	0	49

OBSERVATIONS
Specimens ignited upon introduction to test flame producing minimal light grey smoke, self-extinguishing prior to removal of test flame.
Specimen exhibited no after flame or after glow.

SECTION 10

CONCLUSION

Type 1 Paper Treated with FR Clear 40% had an average char length of 49 mm.

SECTION 11

REVISION LOG

REVISION #	DATE	SECTION	REVISION
0	02/20/24	N/A	Original Report Issue